

PERMIT TO CONSTRUCT

- New
- Renewal
- Modified

Permit No. 3-38-81

This permit hereby authorizes the applicant:

Jenkins John
(Last) (First) (Middle)
Box 204
(Street or P.O. Box)
Big Horn, Wyoming 82833
(City) (State) (Zip Code)

to construct, install or modify a small waste water facility located in (Subdivision) _____

BK _____ LT _____ (Legal Description) Pt SE~~1~~ NE ¼: Sect. 6

T 54 N R 84 W in the County of Sheridan in the State of Wyoming. This permit

shall be effective for a period of two years from the date of issuance.

Authorized by:

Joe H. Thompson, Jr.

Sheridan County Engineer

by John L. Anderson

July 9, 1981

Date of Issuance

Fee Paid.

SMALL WASTEWATER FACILITY PERMIT

SHERIDAN COUNTY, WYOMING

Fee \$25.00

14.17 acres

DTSE $\frac{1}{4}$ NE $\frac{1}{4}$

Subdivision _____ Bk _____ Lot _____ $\frac{1}{4}$; Sec. 6; T 54 N; R 84 W

Owner or Sponsor John Jenkins
 Mail Address Box 204 Big Horn
 Telephone 4-7285

Installer Peto-Rooter
 Mail Address P.O. Box 92
 Telephone 672-3547

GENERAL INFORMATION

- No. of Living Units 1
- No. of Bedrooms 4
- Soil type gravel & clay
- Average of percolation test
1 inch 15 min inches/min.
- Ground slope 2 ft per 100 ft feet/100 ft.
- Water supply
 Municipal _____ Community _____
 Private X well
- Size of lot _____ Acres
- Remarks 150 ft of sch 40 to be used before changing to leach lines


SEPTIC TANK

- Liquid Capacity 1500 gallons
- Material concrete
- Length 10'6" Width 5'6" Depth 6'7"
- Outlet Depth (from ground level) 5 1/2 ft.
- Distance from: Well 100 Waterlines 50

SECONDARY TREATMENT

- Field Bed _____ Other _____
- Total Sq. Ft. Required 760
- Number of lines 3 Ends Connected Yes
- Trench/Bed (width) 2' (length) 400'
- Depth of gravel (below pipe) 12"
 above 6"
- Washed gravel _____ Size 1 inch 40yd+
- Depth of cover over pipe 30 inches
- Distance from: Well 135 Waterlines 50

PLOT PLAN (show lot lines, well, house, direction or slope, water lines, sewer lines, septic tank with dimensions; Indicate North.)

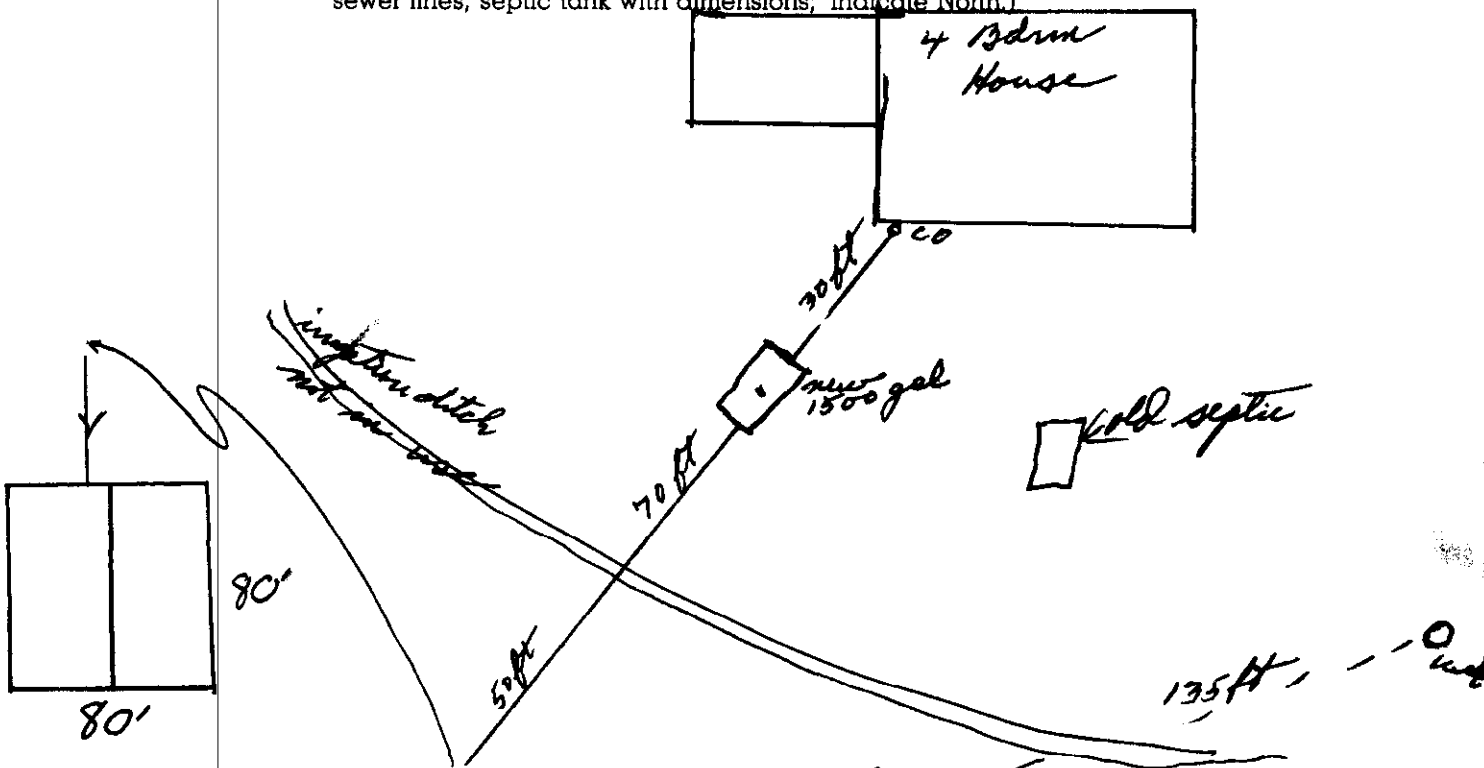

This system will be constructed in accordance with above specifications, design standards and regulations governing sewage systems in the State of Wyoming and Sheridan County.

The plans and specifications as shown are approved.
 COUNTY ENGINEER Joe Hollingsworth
 DATE 7-9-81 by J.O.

APPLICANT Robert Woods
 Do not write below this line.

The above system has been inspected and found to comply with the plans and specifications, but this permit in no way guarantees the continued performance of the system. System shall not be covered until inspected. Request in advance.

Installed by: Robert Woods Inspected by: John Anderson Date: 7-10-81
 Approved: Joe Hollingsworth County Engineer. Date: _____
 by John Anderson